



STANDARD DETAILS

CITY OF SHERWOOD
ARKANSAS

TITLE


CURB INLET – JUNCTION BOX
CIRCULAR MONOLITHIC
CONCRETE CONSTRUCTION
DETAILS

STD-7

Issue Date

January, 2007

Revision Date

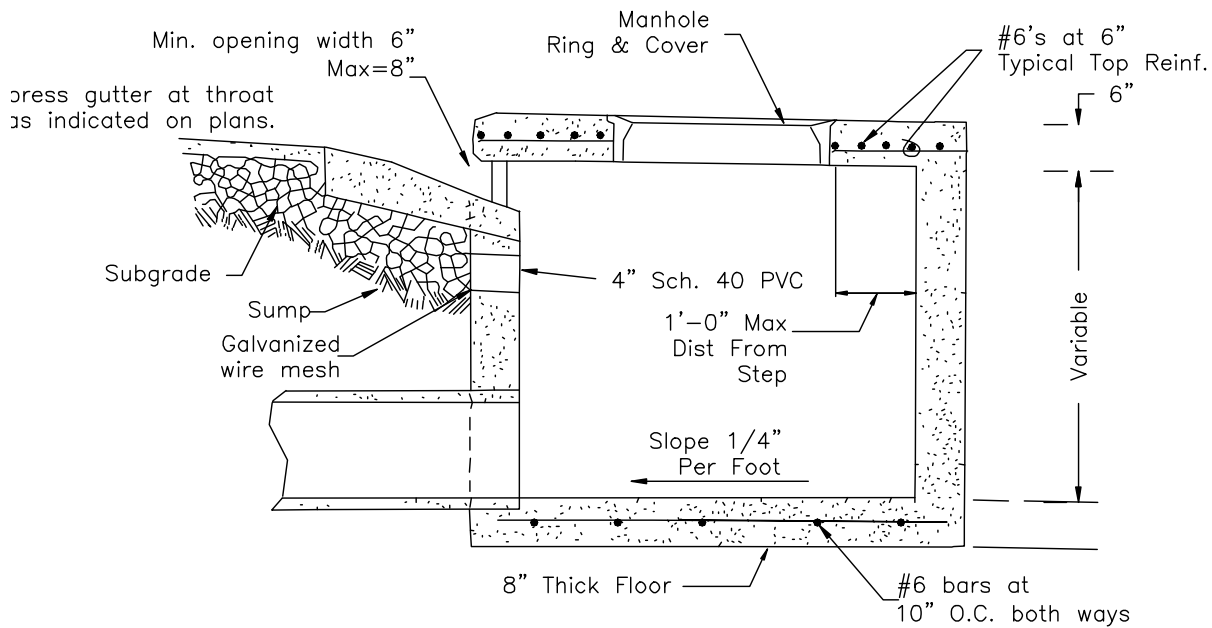

NOTE: Steps required in all inlets exceeding 3'-0" in depth.
Reinforcement not required in circular inlet walls unless
specified on plans.

Depression See Detail STD-11

DIA. OF STRUCTURE	WALL THICKNESS	DIA. OF OUTLET PIPE
4' I.D.	6"	15" Thru 27"
5' I.D.	8"	30" Thru 42"
6' I.D.	8"	48" Thru 54"
8' I.D.	10"	60" Thru 72"